

# THE SMARTER WAY TO TREAT

Kenneth E. Neu<sup>1</sup>, Charles Otis<sup>2</sup>

## Abstract

The paper highlights innovative ways to improve decentralized advanced treatment processes which reduce equipment components, vastly reduce maintenance, improve energy efficiency, and allow for intelligent decision making. An integrated fixed-film Moving Bed Biofilm Reactor (MBBR) treatment system has been developed which is able to operate via a single blower to provide all aeration, mixing, and pumping processes powered by the single air source. These revolutionary smart systems have innovations in technology with very few mechanical or electrical moving parts below water, only where required. A comparison of tank volume required for moving media treatment system versus stationary media treatment system is shown. A case study describes a staged combination of aerated fixed film media and mixing equipment which uses accumulated air to agitate without aerating. The same air-accumulating equipment with modifications is used in pumping in a controlled fashion, which eliminates the need for flow meters and underwater electrical pumps and mixers. The case study features a new and unique combination of equipment used to both remove high strength organic matter to extremely low concentrations (89-98 % removal) and reduce nitrogen 59% to near 80%. This paper describes installation, operation, and maintenance advantages which are additive and may tend to collectively favor an economic advantage over competitive processes in some cases.

KEYWORDS: SMART-Treat®, high-strength, moving media, Point Watch, biofilm<sup>1</sup>

## Introduction

The objectives are to show:

A new combination of technologies which were installed, operated and fine-tuned to achieve Treatment levels which are much lower than state regulations, and

Within smaller tankage than alternative systems

All of which ultimately provides cost advantage to the installer, customer and maintainer.

The Moving Bed Biofilm Reactor (MBBR) fixed film wastewater treatment process, developed in the 80's in Norway, has been widely accepted worldwide and features high surface area small plastic pieces in an aerated reactor with wastewater flowing through it. The MBBR process has historically been known to decrease wastewater treatment plant footprint because of the high fixed

---

<sup>1</sup>SMART-Treat Network & EHS, PO Box 21, Richfield, WI 53076

Phone: (262) 628-1300, E-mail: [ken-ehs@juno.com](mailto:ken-ehs@juno.com), [ken@smarttreat.net](mailto:ken@smarttreat.net)

<sup>2</sup>Pulsed Burst Systems, PO Box 21, Richfield, WI 53076

Phone: (414) 336-0866, E-mail: [charles@pulsedburst.com](mailto:charles@pulsedburst.com)

film surface area per unit volume, as reported by Rusten and Paulsrud (1987, 1996) and Rusten, and Odegaard (2007)

The reactor volume, whether aerobic, anoxic, or anaerobic stage, is totally mixed. The biofilm lives on small plastic pieces freely swimming within the reactors. The movement of the plastic pieces creates its own biofilm sloughing action. Due to the self-cleaning nature of the media and a separate biosolids settling zone, settled waste biosolids recycle to primary settling zone. The aerobic reactor zone itself never needs solids removal, as many stationary fixed film processes do. Rusten and Neu (1999) and Rusten et.al, (2000) indicated this treatment process is especially suited to high-strength small flow waste streams due to its large biological surface area in a small footprint, and self-cleaning media. Likewise, the MBBR process may be designed to remove nitrogen from the fluid stream as reported by Rusten and Odegaard (2007)

For the onsite water recycling industry, the SMART-Treat® MBBR process is used for wastewater flows of up to 100,000 gallons per day or around 200 pounds BOD or less. Since 2001 dozens of small scale MBBR systems were designed, installed, and are operating successfully. It is essential for proper technology transfer to occur when a relatively different way of doing things is introduced. Communication and education regarding the technical specifications set forth for siting, installation, operation and maintenance of these advanced wastewater treatment systems will be handled via a SMART-Treat Network to be established throughout North America. The idea is to have a central communication hub and regional teams to serve the on-site treatment community for domestic, commercial and light industrial applications.

System sizing using an engineered design modeling software program is done for the specific carrier element used. The filling ratio of carrier elements in the reactor may be decided for each case, based on degree of treatment desired, organic and hydraulic loading, temperature, and oxygen transfer capability. Organic loading per 1000 ft<sup>2</sup> of biological surface area is the primary sizing criteria. The MBBR design can be customized for each application, never having to overdesign tankage or surface area unlike many fixed film processes. In general, the MBBR design can be modularized, providing expediency and simplicity of design—within a general set of design parameters. Figure 1a shows sketches of the moving media system. Figure 1b shows a close-up view of healthy aerobic biomass on a biofilm carrier element taken from a municipal treatment system.

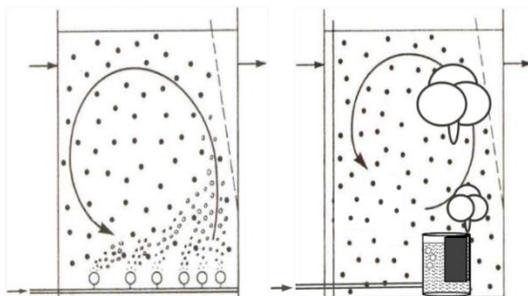


Figure 2a: Aerobic and Anoxic MBBR reactors with carriers moving within tanks




Figure 1b: Typical MBBR carriers

For many MBBR treatment applications, the biological surface area for treatment per cubic foot of reactor volume has 200-400% more biological surface area per volume than typical stationary fixed film processes as reported by Odegaard, Rusten and Siljudalen (1999)

**Onsite Moving Bed Biofilm Reactors have many positive advantages**

Neu and Rusten (1998) pointed out that since MBBRs have 200-400% more biological treatment surface area per unit volume as static or rotating treatment systems, it has begun to gain favor in the US due to the smaller volume requirements and low maintenance requirements. Table 1 shows a comparison of required tank volume for the moving media treatment process versus a stationary fixed film process.

**Table 1.** Volumetric Stationary vs. Moving Fixed Film Biological Surface Area Comparison High Strength Waste, 3317 gallons/day, Influent BOD = 1250 mg/l

	Media surface ft <sup>2</sup> /ft <sup>3</sup>	Ft <sup>3</sup> required	2/3 volume filled (gal)	Treated volume with Bio-Solids separation
Stationary Media	30.5	648	7348 gal	11,000 gal
Biowater BWT-X Media	198 ft <sup>2</sup> /ft <sup>3</sup> bulk 131 ft <sup>2</sup> /ft <sup>3</sup> active	100	1135 gal	2,100 gal

Tank volume difference--- stationary media versus moving media

Volume ratio difference: MBBR Media vs Stationary Media

5.2:1 Bulk Density

4.3:1 Working Density

Note: stationary media requires ample space between media layers to allow microbe attachment without clogging. Moving media supports thin active self-cleaning biofilm.

As shown by Neu (2009) the MBBR process can be used for existing system upgrades or new construction where a small compact footprint is required and comparable systems are too large or cost prohibitive. MBBR systems can be used for small or large activated sludge or fixed film treatment systems, which then create integrated fixed activated sludge (IFAS) systems. Rusten, McCoy, Proctor, and Siljudalen (1998), Rusten, et. al. (2003) and Rusten and Odegaard (2007) pointed out that MBBR systems are highly flexible with regard to influent hydraulic and organic loads, and can be easily integrated into a wide variety of and stages of infrastructure development to successfully treat domestic, commercial, industrial or combined domestic, commercial or light industrial flows. MOP 8 ( WEF, 1998) also refers to MBBR design and operation.

Upgrade of the biological treatment capacity can occur with relative ease when the need arises for larger flows, heavier organic loads, or better effluent quality. A typical plant upgrade consists of the simple addition of biomedea, where it takes only minutes to double the biological surface area without added tankage or excavation. An example of this scenario is a condominium originally

outfitted to SMART MBBR in 2002, then in 2012, nine bedrooms were added. The MBBR reactor tank and air supply were adequate for the increased flow and load. It took 2 days to obtain the sanitary permit to upgrade for higher capacity of treatment and only 15 minutes to add the additional biological surface area required—by simply adding a few dozen cubic feet of carrier elements into the existing aerobic reactor through the manway.

### **Recent Developments**

Unique design features have been incorporated into the process to increase performance and ease of maintenance. One example is to incorporate pulsed air pumping and mixing. The science and mechanism behind the unique combination of this equipment combines aeration, anoxic mixing, and pumping with one low pressure air source.

Simplified enumeration of the recent developments in the MBBR treatment process:

1. The aeration headers, mixers, and pumps have no moving parts.
2. For the MegaBubble™ mixers and pumps, air simply accumulates in an accumulation chamber. When the chamber fills to a certain point, the air is released at once and the surrounding water pressure forces all accumulated air to evacuate the chamber. A repetitive air accumulation and release occur as long as the device receives air flow.
3. The pump is a pulsed air mixer that simply has the bubble generated rise through a riser pipe. Each pulse provides an approximate volume per burst. This allows bursts to be metered and a flowrate to be approximated, providing an easily adjustable recycle rate without the need for flowmeters.
4. For mixing and agitation, the same metered pulses provide the right amount of mixing and can be adjusted accordingly.
5. Control for pulsed air devices may be continuous or on an off/on regime, where a continuous flow of air results in intermittent large bubble events, and these may be turned on and off with a valve or separate blower as desired.
6. A surge flow equalization tank may be mixed with pulsed air mixers as well (and aerated, if desired) with the main system air source or a separate blower.
7. The SMART system may be configured as an integrated fixed activated sludge reactor with the use of Megabubble airlift pump recycle. These mixers and pumps may be used wherever conventional mixing and pumping devices are used, without the need for maintaining electrical equipment other than the air source which activates aeration, mixing & pumping. Very simple, easy & low maintenance.
8. Operator training consists of counting air bursts from mixing and pumps, calculating air mixing or water volume pumped, and air flow valve adjustments to attain desired mixing intensity or airlift pumping rate. After initial settings, simply adjust as needed. Typically no further adjustments are needed.
9. Mixing intensity and pumping rates are usually checked semi-annually, simple manual air valve adjustments take only minutes.

10. For controlling the system, PointWatch online controls are used. PointWatch is an intuitive English based programming language, using <, >, =, commands. These can be set remotely if desired, from a smartphone.

The robust controls PointWatch offers can significantly reduce the control panel size, as many of typical relays, timers, etc., become redundant. The system has functionality that would be difficult to cost-effectively integrate into treatment systems to save time, lower costs associated with site visits. PointWatch has an easy to understand human machine interface system. It is what everyone already has in their pocket – their smart phone. Operators can remotely monitor and control all aspects of the plant, such as level, pump status, flowrates, etc. This same system provides alarms and collects data. There is a short learning curve to become familiar with the monitoring and control concepts of the Point Watch system. A general training session of an hour can familiarize individuals with basic cell phone use knowledge. After this point, on-the-fly programming is easy, with the ability to set points or counters using simple logic, instead of ladder logic programming. This may be done remotely.

These design upgrades vastly simplify onsite treatment, reducing maintenance, reducing equipment costs, increasing flexibility, and increasing the robustness of control.

### **Materials, Methods and Design Rationale**

A SMART-Treat® MBBR system using MegaBubble® pulsed air mixing and pumping technology was installed in late October 2018. The owners of a small multi-unit commercial property off I-94 in western Wisconsin needed to upgrade the capacity of their failing wastewater treatment system. The existing design was < 1200 gallons per day and the new design flow was 3500 gallons per day. The treatment load included brewery and restaurant waste, as well as mixed use facilities. The existing septic tanks included small aeration devices which did reduce organic load, but not enough to prevent a premature drainfield failure. The commercial property owners desired to maximize available commercial rental area. A new advanced wastewater treatment system was necessary.

For this high strength waste application, the primary aerobic treatment goal was to reduce 616 mg/l BOD to 200 mg/l BOD, 150 mg/l TSS. The effluent requirements were defined by a State of Wisconsin regulatory rule, summarized, requires high strength waste to be reduced to typical domestic strength septic system effluent quality prior to soil treatment and absorption. Wisconsin does not have a nitrogen reduction regulation at this time. However, onsite advanced SMART systems typically also reduce nitrogen—advantageous for planet and people.

The primary biological treatment process was originally designed as a generic Fixed Activated Sludge Treatment (FAST) process. That design gained regulatory review and approval. However, the property owners requested the designer to search for other potential alternatives that might be lower cost and accomplish the treatment required. The owner's decision was to replace the biological treatment design in favor of the SMART-Treat moving media system design. All other parts of the system were kept the same. With minor delay for regulatory approval, the SMART-

Treat system saved the owners over \$ 60,000 from the anticipated costs of the generic Fixed Activated Sludge Treatment design.

The original total treatment system consisted of existing a 1000 gallon grease trap, two 2000 gallon septic tanks in series, and an overloaded subsurface drainfield. The septic tanks were previously outfitted with aeration units which were undersized for the organic load. These units were scrapped in favor of SMART-Treat.

New infrastructure upgrade included a 3000 gallon surge flow equalization tank (as originally specified for the fixed activated sludge system upgrade). The revised aerobic treatment system has three moving bed fixed film stages: BOD reduction, nitrification, and post-denitrification—in a total biological treatment tank volume of 3850 gallons, compared to the design volume of 6,010 gallons. No carbon is added, internal recirculation is achieved with a MegaBubble pulsed-air pump operated with air from the main aeration blower. The anoxic stage is mixed with MegaBubble pulsed-air mixers from the main process air source. The layout shown in figure 2.

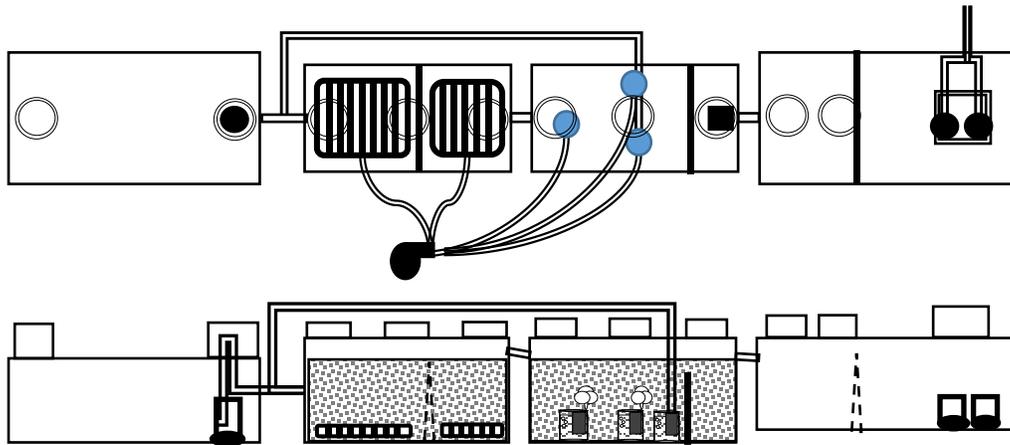


Figure 2: Layout of the W. Wisconsin system. Top view above, side view below.

The advanced system consists of two aerobic fixed film biological treatment stages followed by post-denitrification, two-stage clarification, and pump tank to new replacement soil absorption area. The biological surface area was sized for present design flow of 2350 gpd, all other system components and drainfield were sized for maximum design flow of 3500 gallons per day. As treatment needs increase, adding biomedia by simply pouring it into tank, will achieve biological surface area for maximum design flow. Surface area for present design flow: 176 ft<sup>3</sup> Biowater Technology model X media with a surface area of 198 ft<sup>2</sup>/ft<sup>3</sup> for a total protected surface area of ~35,000 ft<sup>2</sup> for a fill fraction of 47%. For the continuous maximum flow of 3500 gpd, the basins will be filled to 247 ft<sup>3</sup> of media or a fill fraction of 67%. Organic Load to biological treatment remains at 0.34-0.37 lb. BOD/1000 ft<sup>2</sup>/day. At design flow and load the system is sized for 125 population equivalents at the septic tank effluent flowing to the SMART system. The design hydraulic residence time for the biological step is 26.4 hours.

## Online Control and Monitoring

PointWatch systems manufactures an intelligent monitoring and control system that is accessible via computer or a smartphone app. The very lightweight design uses a 485 bus to run various inputs and outputs (i.e. it monitors systems, but also can output commands). This lightweight system can virtually replace a PLC, leaving a control box to house only contacts and relays – which can reduce control panel costs significantly. Currently the system is set up to monitor the existing control panel and can also control pump and blower settings. It does render much of the control system redundant, and adds quite a bit of functionality. (PointWatch, 2019)

A state licensed laboratory (Commercial Testing Laboratory, Colfax, WI) conducted laboratory analysis of grab samples brought in from septic tank effluent and post treatment locations. Sampling was conducted using standard EHS SMART-Treat sampling protocol published and provided to the States of Wisconsin and Minnesota regulatory agencies by Neu (2014). Initial sampling occurred in January 2019, with follow up sampling events in May, July and September. Sampling dates coincided with times personnel were in the area, since sampler personnel were normally 3.5 and 5.5 hours from the site. Samples were collected during normal business hours between 10 AM and 1 PM using a cleaned plastic tube sampling device with a ball foot valve, lifting the sampling tube up and down several times to draw water into the tube. Sampling depth was approximately 10-20 inches below the water surface in each of two sampling locations.

## Results

The original design was to remove BOD and TSS. However, the SMART-Treat design can be shown to achieve much better effluent quality than the prior-designed system, and in a smaller tank volume. Analysis of samples also included nitrogen species: Total Kjeldahl Nitrogen (TKN), ammonia-nitrogen, and nitrite + nitrate-nitrogen parameters, despite not being a requirement for the permit.

The January sampling showed appreciable decrease of BOD & TSS values at the pump tank to the drain field, compared with target effluent goal. Design wastewater flow & organic load for biomedica surface area supplied at start up 2350 GPD, 12 lb. BOD/day. Table 2 shows further sampling results.

**Table 2:** SMART-Treat sampling data, multi-unit commercial property, including restaurant and micro-brewery. Note that it is safe to assume there is no nitrate in the septic tank effluent, so Total Nitrogen at the influent to aerobic treatment is organic/ammonia-N. Total Nitrogen Reduction is calculated by subtracting the sum of the aerobically treated nitrate and TKN from the septic tank effluent TKN and then dividing by the septic tank effluent TKN. Example: 7/26/19 87.3 – (15.3+20.8) / 87.3 = 0.5865, rounded up = 59% Nitrogen reduction.

Date	Design Values, (mg/l)	Surge Flow Equalization tank (septic tank effluent)	Pump Tank (Aerobically Treated)	Target Effluent Concentration (mg/l)	% Reduction
------	-----------------------	---	---------------------------------	--------------------------------------	-------------

01/27/19	BOD	616		45	220	
	TSS	220		68	150	
05-08-19	BOD	616	1360	20	220	97%
	TSS	220	364	36	150	84%
	TKN		117	17.9		85%
	Ammonia-N		83.8	7.6		91%
	Nitrate-N			6.4		79% TN reduction
07/26/19	BOD	616	858	20	220	98%
	TSS	220	67	17	150	75%
	TKN		87.3	15.3		82%
	Nitrate-N			20.8		59 % TN reduction
09/20/19	BOD	616	473	3	220	99%
	TSS	220	138	10	150	93%
	TKN		65.1	6.6		90%
	Nitrate-N			7.6		79% TN reduction

Average of three influent/effluent sample sets, May-Sept.	Design Values, (mg/l)	Surge Flow Equalization tank (septic tank effluent)	Pump Tank (Aerobically Treated)	Target Effluent Concentration (mg/l)	% Reduction
BOD	616	897	14	220	98
TSS	220	190	21	150	89
TN	-	90	25	-	72

## Discussion

The situation which prompted the wastewater treatment upgrade was the need for a better method of wastewater disposal. The existing drainfield had failed, likely due to being too small for the high strength waste load and inadequate amount of treatment. The SMART-treat small flow onsite moving media wastewater treatment system is well suited for treatment of high strength wastewater prior to subsurface dispersal. Although the plumbing contractor who installed the system is only 10 miles from the treatment site, a remote monitoring system was installed as an early alert system in the event of pump or blower maintenance needs or failure. The system location is not readily visible from the majority of property tenants and a nearby freeway is has a constant flow of traffic, so visual or audible warnings could be missed. The remote monitoring system is also needed because the system owners are not in the immediate area. The system owner

is the primary stakeholder in the equipment selection process. Plumbing contractors and system designers also need to be educated regarding alternatives.

As is typical of many commercial and light industrial wastewater flows, organic and solids loadings may vary widely from day to day. For this case study, Total Suspended Solids of the septic tank effluent (aerobic treatment influent) ranged from 67 mg/l to 364 mg/l. (over a 5 fold increase from minimum to maximum values). However, average TSS reduction for the three sample sets was 89 % removal. Trends and averages are better indicators of total system performance than individual day results.

The reasons why the treatment system exceeded treatment goals and produced excellent nitrogen removal were:

1. The biological surface area of the SMART MBBR was over 35,000 square feet at present wastewater flow and load, and will be 49,000 square feet at design load. (Comparable stationary media surface area would have been around 16,000 square feet at full design load). At full design load MBBR has OVER 300 % more microbe surface area to treat wastes.
2. The comparable Fixed Activated Sludge Treatment system was proposed to be a single stage treatment system in 6000 gallons while the SMART system was installed as a 3-stage system in 3850 gallons aerated, or only 64% of the volume needed for stationary media.
3. The main aeration blower powered the anoxic pulsed mixing of stage 3 and pulsed airlift internal recirculation to higher carbon stage 1 and aided treatment. Energy for pulsed air mixing and pumping was negligible.
4. Due to the self-cleaning nature of the moving media, a thin, healthy biofilm is promoted as pointed out by Mosey (1996). Biofilm thickness control may at times become an issue for biofilms typical of stationary sheet media or even rotating media.

In this case study, average Total Nitrogen Reduction of the samples taken was over 70% reduced—without the need to do so from a state regulatory standpoint. A higher microbe density, recirculation to the surge flow tank instead of first aerobic treatment tank and slightly longer hydraulic residence time may have led to even greater nitrogen reduction. Compared to some states regulations, 50 % Total Nitrogen reduction is an acceptable nitrogen reduction, while TN reduction to 10 or 20 mg/l Total Nitrogen is a suggested goal for some onsite systems in some states. (Colorado Department of Public Health and Environment, Minnesota Pollution Control Agency). NSF 245 addresses nitrogen reduction as well. (NSF/ANSI 245) for domestic wastewater flows of up to 1500 gallons per day. However, there is no public NSF guidance at this time for nitrogen reduction in high strength waste applications.

The major driving factor which prompts equipment selection is usually total system capital cost (CAPEX) and operating cost (OPEX). This is especially true when the system owner(s) are involved in system selection. In this case system owners saved over \$ 60,000 by switching to the SMART system. The switch from competitive systems to the SMART-Treat® system has occurred in the past (Neu, K., 2009) when in 2005 \$ 15,000 was saved when a 3317 gpd design high strength

waste stream was treated with SMART MBBR process rather than competitive process. The demand for more affordable onsite treatment systems with less O&M cost with the ability to produce a higher quality effluent is likely to increase in the future, as word spreads that there are lower cost options which provide better treatment with less operation and maintenance cost. For example, a biological treatment system of this 3,500 gpd design flow on an annual estimated basis may cost:

\$ 875/yr. for estimated energy cost (@ \$ 0.09/KWH)

\$ 860/yr. estimated preventive maintenance & remote monitoring

\$ 500/year- estimated equipment replacement fund

\$ 2235/yr. total estimated long term O&M cost (\$ 6.12/day)

For this SMART system, minor punch list items were addressed by the installation contractor after initial construction. A Pointwatch control system was added for monitoring blower, liquid level, pump status, and for sending alarms at limits to the operator. Startup punch list items included addition of several check valves to prevent siphoning from sumps. Blower filter was changed May 9. Also, adjustments were made to frequency of bubble events in anoxic mixing zone and for nitrate recycle pump. A preventive maintenance agreement is in force and on file. Review, evaluation and active fine-tuning of the system is accomplished during each 6 month interval preventive maintenance visit. After initial operational settings were established, the 6-month low maintenance interval is sufficient to keep the treatment system in peak performance mode.

### **Case Study Summary & Conclusions**

- The SMART-Treat® process was selected after regulatory design approval versus a competing fixed film treatment process which was more expensive. Plan change approval occurred rapidly, construction commenced and operation of the system was started on time October 2018.
- Laboratory analysis of influent and effluent over the sampling period resulted in 98 & 89 % reduction of BOD & TSS respectively, or average of 14 & 21 mg/l BOD & TSS, compared to effluent targets of 220 & 150 mg/l BOD & TSS.
- Total Nitrogen reduction averaged 72%, range of 59-79 % TN reduction. (TN was not regulated)
- Treated water with biosolids from the post-denitrification stage was recycled with the pulsed air pump to the first aerated reactor, which provided extra treatment of the high strength waste.
- The anoxic post-denitrification tank is mixed with pulsed air mixers in this low DO nitrogen reduction zone. Despite the use of air for mixing, a low dissolved oxygen concentration was maintained for adequate denitrification.
- Settled waste biosolids from the clarifier were recycled to the septic tank on a timed dose basis for ultimate disposal. Pumping not necessary to remove biosolids from aerobic tanks.

- Unique features were included in the design and added after construction in order to enhance treatment and provide ease of monitoring and control.
- The PointWatch system was installed in August of 2019, which rendered much of the control panel redundant. Remote monitoring of pump run times, blower & pump amperage readings and alarm conditions and online control of pump ON /OFF sequencing makes operational decisions easy, eliminating unnecessary trips to the site, while still being notified if anything is wrong.
- Online graphing of data makes for easier decision making by the lead system maintenance operator and allows for decisions to be made, ultimately saving time and money.

The objectives of the study were met:

1. Using only one (1) low pressure air supply, pulsed air anoxic mixing and airlift pumping equipment was installed in addition to aeration, to achieve substantial nitrogen reduction and lower than regulation organic loading to subsurface discharge. A monitoring system was installed to remotely monitor and control/fine tune operation from afar.
2. A few sets of samples were collected and analyzed at a commercial testing laboratory to prove that treatment levels are much lower than state regulations required.
3. Installed biological treatment tankage is more than 35% smaller than initially planned alternative treatment tankage requirements, yet an average of 72% Total Nitrogen reduction was achieved. Competitive processes may have required over 300 % increase in biological treatment tank volume and related equipment to achieve equivalent treatment.
4. The sum total of the new SMART-Treat MBBR system with pulsed air equipment enhancements ultimately provided \$ 60,000 installation cost savings to the owners and system installer. The plant pumps and blower can be monitored and adjusted remotely if needed, which provides cost savings for the system maintainer. The pulsed-air technology has allowed for low maintenance because there are no electrical motors, gear reducers or other mechanical moving parts which require mandatory rebuild or replacement, other the main air blower. Cost saving is mainly from no moving parts to maintain, rebuild or replace. Service life of pulsed air mixers or pumps could be in the +40 year range.

#### **Benefits include**

- Economical treatment with savings of over \$ 60,000 compared to the original specified due to a smaller footprint and lower installation cost.
- Ease of incorporation into an existing approved design.
- After initial operation set up there is minimal maintenance and simple operation.
- Efficient pulsed air pump used for recycle flow powered by the main aeration blower.

- Pulsed air mixers in the anoxic zone use air from the main process air source, which eliminates separate air source to service, maintain, replace, and save costs for separate motors to be purchased and run.
- Economical running costs, especially given the degree of nitrogen reduction achieved.
- The aerobic reactor never needs cleaning. The waste biosolids timed dose pump directs settled waste solids to the septic tank for disposal.
- Self-cleaning biological surfaces – media clogging is never an issue.
- Treatment capacity can be added within existing tankage if necessary
- Remote online monitoring and control add process reliability and security.

### **Acknowledgements**

Thanks to the commercial development owners for their research efforts which led them to save over \$60,000 with SMART-Treat® MBBR. Thanks to the plumbing contractor, Countryside Plumbing & Heating. The contractor was on site for the fine installation work, including follow-up punch list resolutions.

### **References**

- Colorado Department of Public Health and Environment.  
REGULATION NO. 43 - ON-SITE WASTEWATER TREATMENT SYSTEM REGULATION
- Minnesota Pollution Control Agency, Subsurface Sewage Treatment System (SSTS) Regulations.
- Mosey, F.E. 1996. Biofilms on Kaldnes carrier particles. Proc. from seminar organized by Anglian Water. Cambridgeshire, UK 27-29 November 1996
- Neu, Kenneth E. and Rusten, Bjørn 1998. The Kaldnes moving bed biofilm reactor (MBBR) process for on-site and small flows wastewater treatment or plant upgrades. Poster presented at IAWQ Water Quality International 1998, Vancouver, BC, June 21-26, 1998.
- Neu, K.E., 2009. Small Flow High Strength Waste Gets "Super-Charged" Treatment With Good Results. WEFTEC, (October, 2009), Orlando, Florida.
- Neu, K., 2014. EHS SMART-Treat Sampling Protocol, Provided to the Minnesota Pollution Control Agency.
- NSF/ANSI Standard 245 –Wastewater Treatment Systems –Nitrogen Reduction requires reduction of 50 percent rather than an absolute value.
- Ødegaard, H.; Rusten, Bjørn and Siljudalen, Jon G.1999. The development of the moving bed biofilm process – From idea to commercial product. Paper presented at Innovation 2000, UK, Also in EWPCA Journal European Water Management, (Vol. 2, No. 3, pp. 36-43), 1999.

PointWatch 2019. PointWatch overview and brief list of operator benefits. PointWatch.com

Rusten, Bjørn and Paulsrud, Bjarne 1987. Recent advances in wastewater treatment in Norway. Proceedings of the 6th NATO/CCMS AWT-group meeting, Burlington, Ontario, (May 5-7, 1987, pp.?)

Rusten B., Kolkinn O., and Odegaard H., (1994, 1997). Moving bed biofilm reactors and chemical precipitation for efficiency treatment of wastewater from small communities.1994, Proceedings from WEFTEC 1994. Chicago, Illinois. Oct., 17. (Paper #AC 94 13 05. 1997), Water Science & Technology, (Vol. 35, No. 6, pp. 71-79).

Rusten, B., Siljudalen, J. G., Nordeidet, B. 1994. Upgrading to nitrogen removal with the KMT moving bed biofilm process. *Wat. Sci. Tech.*, (Vol. 29, No. 12, pp 185-195)

Rusten, B., Hem, L., Ødegaard, H. 1995a. Nitrification of municipal wastewater in novel moving bed biofilm reactors, *Water Environment Research*, (Vol. 67, No.1, pp75-86)

Rusten, Bjørn and Paulsrud, Bjarne 1996. Development of new technology for treatment of municipal wastewater. Pre-project report I: Literature study on the use of ozone. (Aquateam report no. 97-169.1996)

Rusten, Bjørn; Wien, Asgeir; McCoy, Mike; Wessman, Flemming; Thoresen, Hans and Lundar, Arne, 1996: Laboratory scale tests of the Kaldnes Integrated Fixed Film Activated Sludge (IFAS) process for nitrification. (Aquateam report no. 00-016, July 2000).

Rusten, B., McCoy, M., Proctor, R. and Siljudalen, J.G. 1998. The innovative moving bed biofilm reactor/solids contact reaeration process for secondary treatment of municipal wastewater. *Water Environment Research*, (Vol. 70, No.4, pp 1083-1089)

Rusten B., Neu, K.E., 1997. On-site wastewater treatment with the Moving Bed Biofilm Reactor. Environmental / Health Products & Service., PO Box 21, Richfield, WI., USA

Rusten, B., and Neu, K. E., 1999. "Moving Bed Biofilm Reactors Move into the Small Flow Treatment Arena." *Water Environment & Technology*, January, 1999, 27-38.

Rusten, Bjørn; Nielsen, Ine M.; Welander, Thomas and Rasmussen, Vibeke 2003. Increasing the capacity of activated sludge plants by using an AS/MBBRTM hybrid process with Kaldnes biofilm carriers. Paper presented at the 5th IWA Biofilm Conference, Cape Town, South-Africa, September 14-19, 2003.

Rusten, Bjorn and Ødegaard, H. 2007: Design and Operation of Moving Bed Biofilm Reactor Plants for Very Low Effluent Nitrogen and Phosphorus Concentrations. *Water Practice*, (Vol. 1, No. 5, November 2007, doi: 10.2175/193317707X256982).

Water Environment Federation 1998. Manual of Practice No. 8, "Design of Municipal Wastewater Treatment Plants", Alexandria, VA.