


**dose volume**


1. Amount of effluent delivered to the distribution system during a dosing event including the drainback volume, pipe fill volume and the delivered dose volume;
2. Amount of effluent delivered as determined by the pump on and pump off levels in a demand dosed system.

*dose volume images/graphics:*

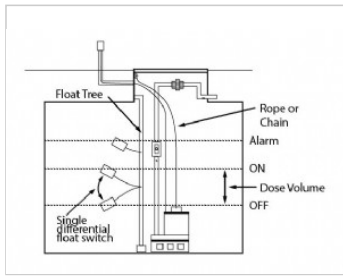


**Demand dosing two float**

Dosing tank with demand dosing controls (one single differential for on/off pump operation plus an alarm float) with labeled dose volume

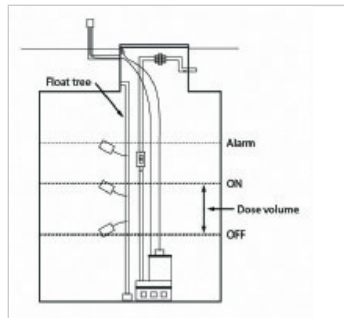


**Demand dosing three float**


Dosing tank with demand dosing controls (two floats for on/off pump operation plus an alarm float) with labeled dose volume

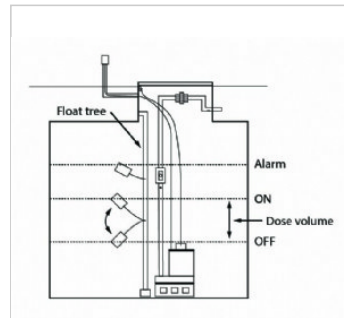

**Demand dosing two float**

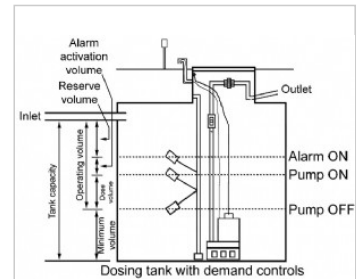

**Volumes - dosing tank**

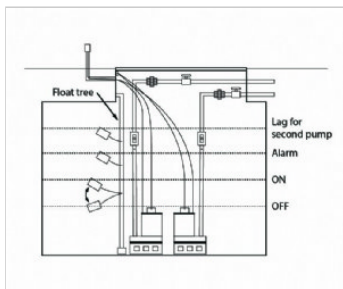

**Demand dosing, duplex pumps and float controls**

Dosing tank with dual alternating pumps with float controls configured for demand dosing